


DEPRESSED GUTTER 2" AT OPENING


METAL TOP REQUIRED ON HIGH TRAFFIC STREETS

### ISOMETRIC CURB CUT OUT N.T.S.

### PLAN CURB CUT OUT N.T.S.

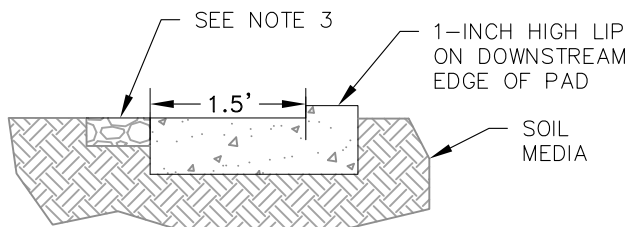

### SECTION A-A

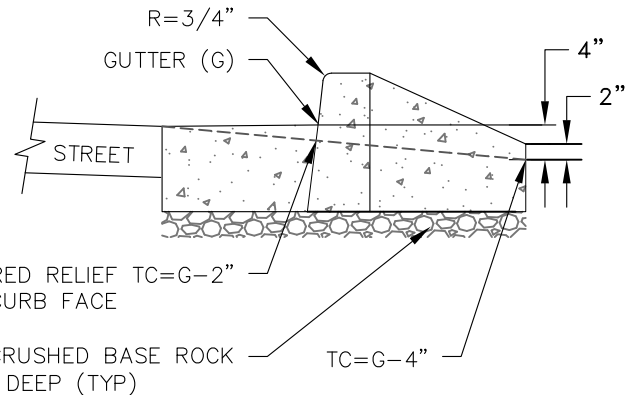

### SECTION B-B

NOTES:

1. CURB CUT SHALL HAVE MINIMUM 2" DROP AT THE FLOW LINE LEADING TO THE SPLASH PAD,
2. MIN DISSIPATION PAD LENGTH OF 18 INCHES AND INSET 4 TO 6 INCHES BELOW TOP OF SOIL. FOR PLANTERS WITH WIDTHS >1.5 FT, THE PAD MUST BE EXTENDED THE WIDTH OF THE PLANTER AND HAVE A 1-INCH LIP ON THE DOWNSTREAM EDGE.(SEE SECTION A-A).
3. ROCK (1- 1/2" - 3/4") ON UPSTREAM EDGE OF DISSIPATION PAD MUST COMPLY WITH ODOT SPECIFICATION 00430.11. INSET ROCK 2" INTO SOIL.
4. SEE DETAIL SD2-02 FOR CURB AND GUTTER DETAIL ADJACENT TO CURB INLET

ADAPTED FROM CLEAN WATER SERVICES



City of Lake Oswego  
Engineering Division

Erica Rooney, P.E. City Engineer

### CURB INLET

# SD9-02

EFFECTIVE DATE: SEPTEMBER 14, 2020 NOT TO SCALE

DRAWING NUMBER